



## Building Division

45 MIN. F.R.R.  
EXT. WALL  
GABLE ROOF

## FIRE RESISTANCE RATINGS

DATE:


JANUARY 2013

SCALE:

N.T.S.

DRAWING NO.:

9-15a

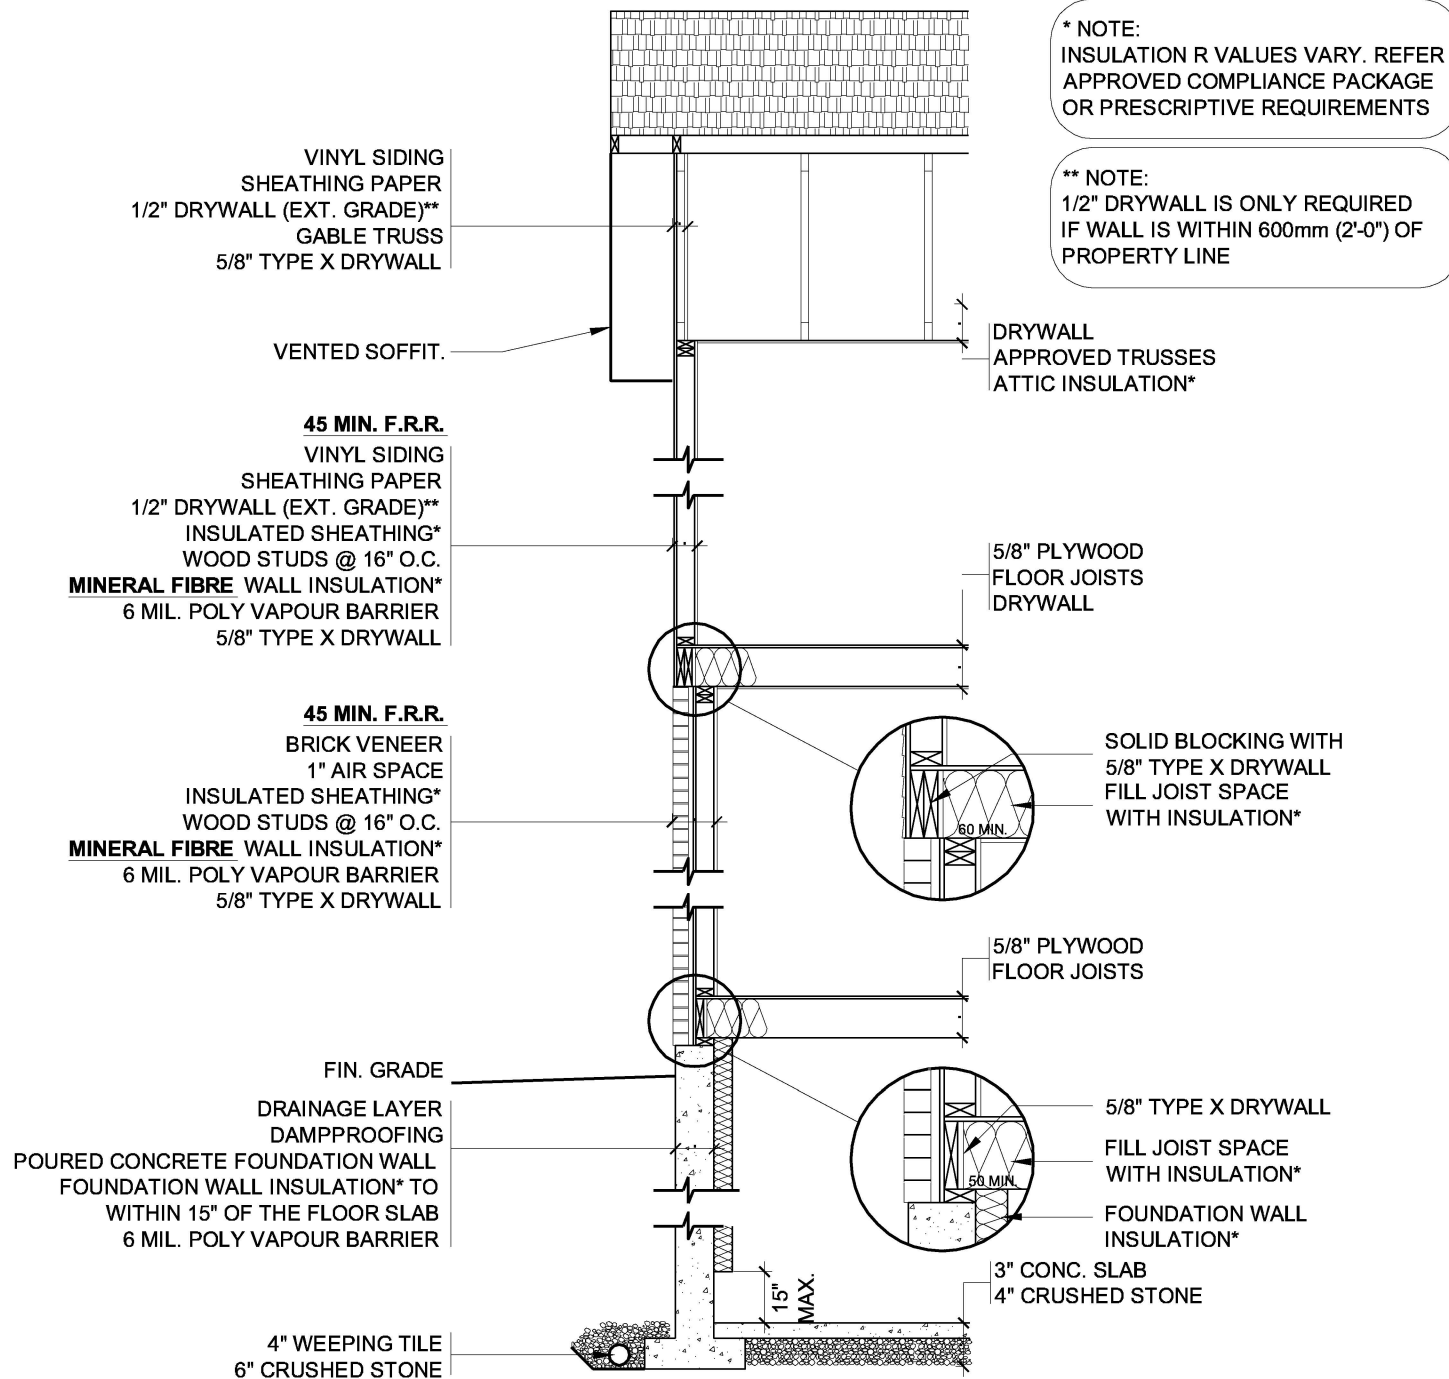



## Building Division

45 MIN. F.R.R.  
EXT. WALL  
HIP ROOF

## FIRE RESISTANCE RATINGS

DATE:

JANUARY 2013

SCALE:

N.T.S.

DRAWING NO.:

9-15b

\* NOTE:  
INSULATION R VALUES VARY. REFER  
APPROVED COMPLIANCE PACKAGE  
OR PRESCRIPTIVE REQUIREMENTS

\*\* NOTE:  
1/2" DRYWALL IS ONLY REQUIRED  
IF WALL IS WITHIN 600mm (2'-0") OF  
PROPERTY LINE

45 MIN. F.R.R.  
VINYL SIDING  
SHEATHING PAPER  
1/2" DRYWALL (EXT. GRADE)\*\*  
INSULATED SHEATHING\*  
WOOD STUDS @ 16" O.C.  
**MINERAL FIBRE WALL INSULATION\***  
6 MIL. POLY VAPOUR BARRIER  
5/8" TYPE X DRYWALL

45 MIN. F.R.R.  
BRICK VENEER  
1" AIR SPACE  
INSULATED SHEATHING\*  
WOOD STUDS @ 16" O.C.  
**MINERAL FIBRE WALL INSULATION\***  
6 MIL. POLY VAPOUR BARRIER  
5/8" TYPE X DRYWALL

FIN. GRADE  
DRAINAGE LAYER  
DAMPPROOFING  
POURED CONCRETE FOUNDATION WALL  
FOUNDATION WALL INSULATION\* TO  
WITHIN 15" OF THE FLOOR SLAB  
6 MIL. POLY VAPOUR BARRIER

4" WEeping TILE  
6" CRUSHED STONE

